



KIWWTP Electrical Substation 1 and Primary Switchgear Replacement

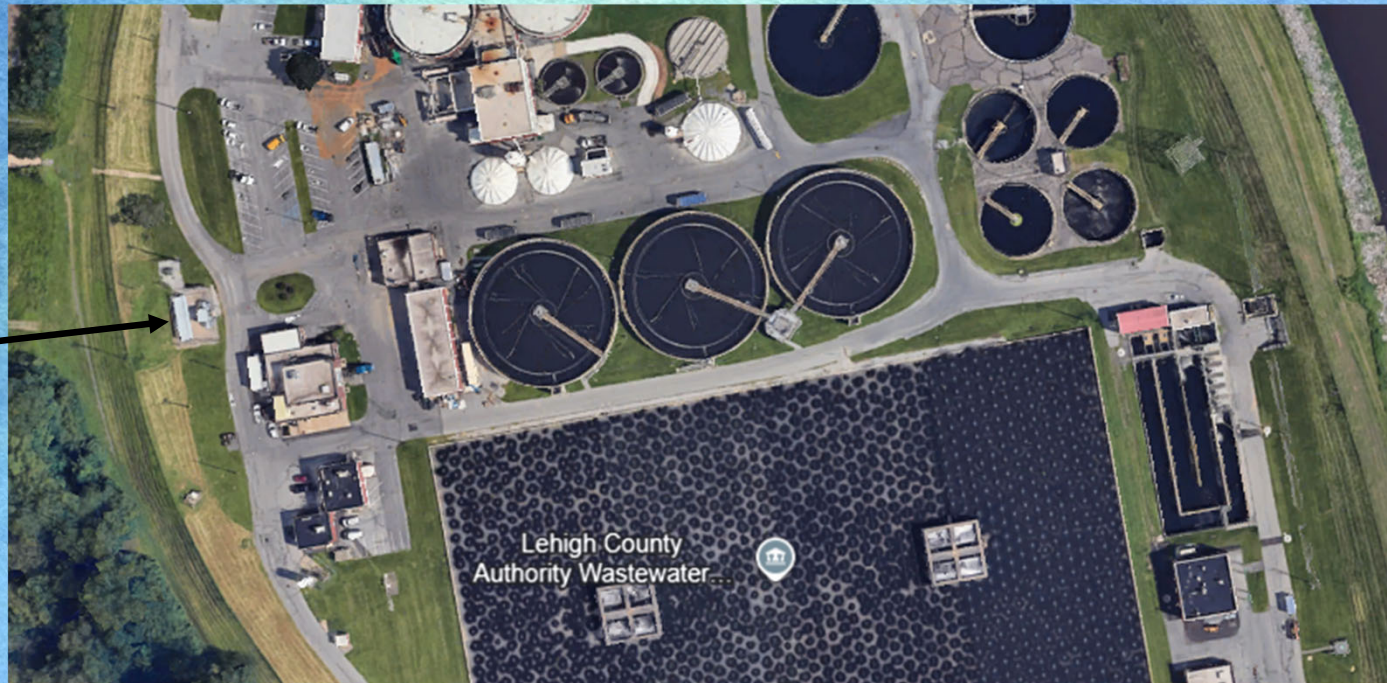

Existing
Switchgear &
Substation 1

Damaged Feeder Cable to MCC-14

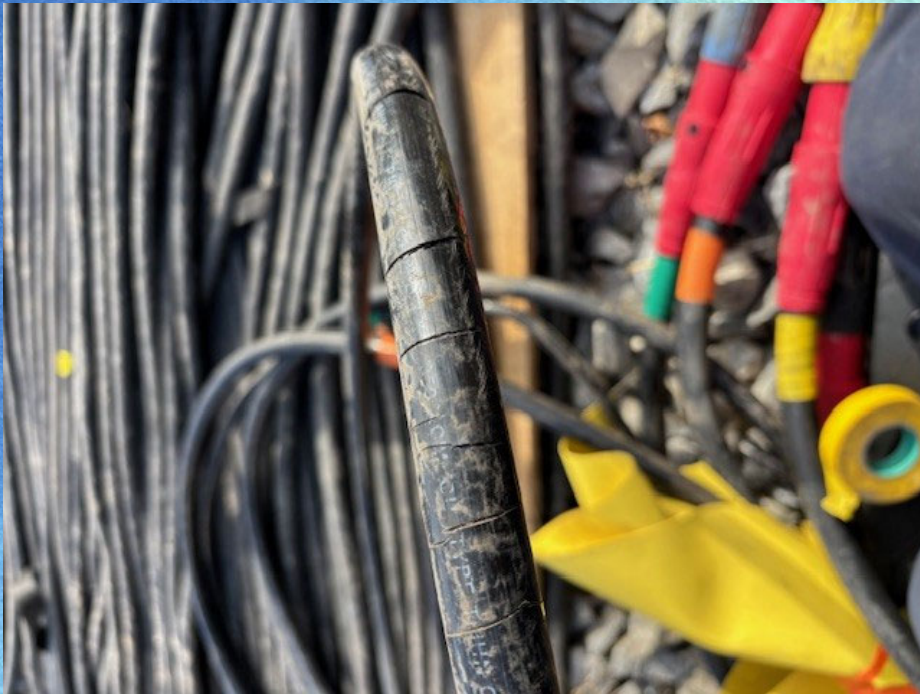

New Feeder Cable to MCC-14

Approximately 5,240
feet of 350 MCM
XHHW feeder cable.



Approval Request:

- *Prior Authorizations – Original Electrical Construction Contract (12/11/23)= \$4,974,999.00*
 - Change order # 1 (12/19/24) = \$ 4,479.26*
 - Change order #2 (9/8/25) = \$ 109,481.89*
- Change Order #3 Request –Philips Brothers Electrical Contractors, Inc. = \$ 81,727.06

Updated Electrical Construction contract total = \$ 5,170,687.21