


High Priority Alternatives to Address Emergency Supply Need

Address current and anticipated reliable supply needs in CLD

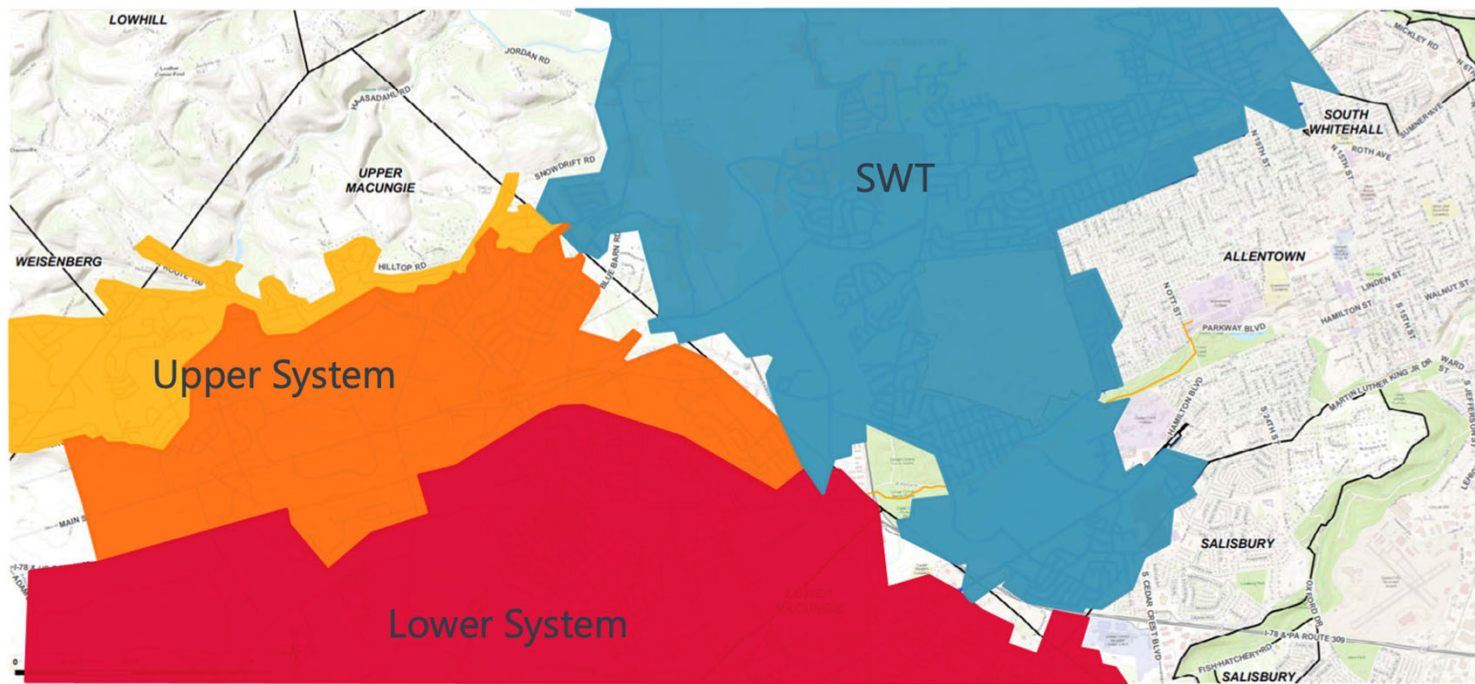

1. Re-establish the Bortz Emergency Interconnection with SWT
2. Re-establish the Interim Schantz Spring Booster Station
3. Establish the Schantz Spring Transmission Main Emergency Interconnection with SWT

Source Water Assessment: Central Lehigh and North Whitehall Divisions

**LEHIGH COUNTY AUTHORITY and
SOUTH WHITEHALL TOWNSHIP
EMERGENCY INTERCONNECTION AGREEMENT**
Bortz Property (Cetronia Road & Schantz Road)

